

### NOTICE INVITING QUOTATION

File No. AIR/GHY/FM/10(2)/2024-25/E /2848

Dated: 27/12/2024  
12 7 DEC 2024


Subject: - Work for supply & installation (SITC) of **02(two) numbers Electrical Earthing** for combiner unit of FM Transmitter at Narkashur Hill .

Dear Sir,

This office is interested in the under mentioned works as per the specifications given below. Your quotation is invited as per the terms and conditions given below.

Sl. No.	Description of work	Qty.
1.	Making of <b>two no's</b> of copper plate earth pits. The work includes Supply & fixing of Copper plate earthing system consisting of copper Plate size 600mm x 600mm x 3.15mm including all accessories such as watering pipe & funnel and masonry enclosure at top with cover plate as per drawing no.TM-16599 (Copy attached).	01 Job.
2.	Supply & laying of 25 x 3 mm copper strip (electrolyte) 300 mm below the earth up to the earth point inside the bldg..  (Rate must be quoted for 15 mtr by tenderer) Actual quantity shall be paid to the tenderer. The payment of copper strip will be made as per actual measurement i.e. if actual length is more or less than 15Mtrs, then per mtr length will be calculated for quoted price for 15 mtr and payment will be made for extra length or deducted for reduced length.	15 mtr

Yours' faithfully,

  
27-12-24

Akhlesh Chand Yadava  
Assistant Engineer  
For, Dy. Director General(E)/HOO,  
Akashvani Guwahati




Terms and conditions: -

1. The rates should be indicated in figure as well as in words.
2. The quotation should be sent to the undersigned by name along with the descriptions of works/ items, name of supplier/ Contractor and specification etc. as per requirement of this office. The terms and conditions, validity period etc. should separately be mentioned in cover envelop or ignore whichever is not necessary. The same must be sealed and containing quoted prices, GST etc. to be furnished in the quotation or in the quotation form enclosed herewith so as to reach within 12.00 hours on or before 17/01/2025 in sealed cover, quotations by giving the following details.
  - a. Works/ stores/ items for which quotations are enclosed.
  - b. Reference of enquiry letter.
  - c. Date of opening quotations.
  - d. Name and address of the Tenderor.
  - e. Details of quotation should be submitted in the enclosed form or firm's quotation form.
3. The quotations will be opened in the Office of the undersigned at 3.00 p.m. on 17/01/2025 in the presence of the tenderor or their agents who may choose to attend.
4. The quotations as submitted should remain open for acceptance for a period of 6 months from the date of opening.
5. Every care has to be taken for the safety of the operating/ carrying the above-mentioned works/ stores/ items at the risk of Supplier/ Contractor.
6. The quotation should be fulfilled with the requisite particulars for GST implication.
7. The DDG(E)/ HOO, Akashvani Guwahati reserves the right to reject any or all the quotations without assigning any reasons.
8. The quality of work should be guaranteed for 1 (one) year after completion.
9. This office reserves the right to terminate the contract if the workmanship is found unsatisfactory. The decision of Head of Engineering in the matter will be final and undisputable. Income Tax will be deducted from firm's bill at the prescribed rates and the prescribed certificate for TDS will be issued.

Copy to:

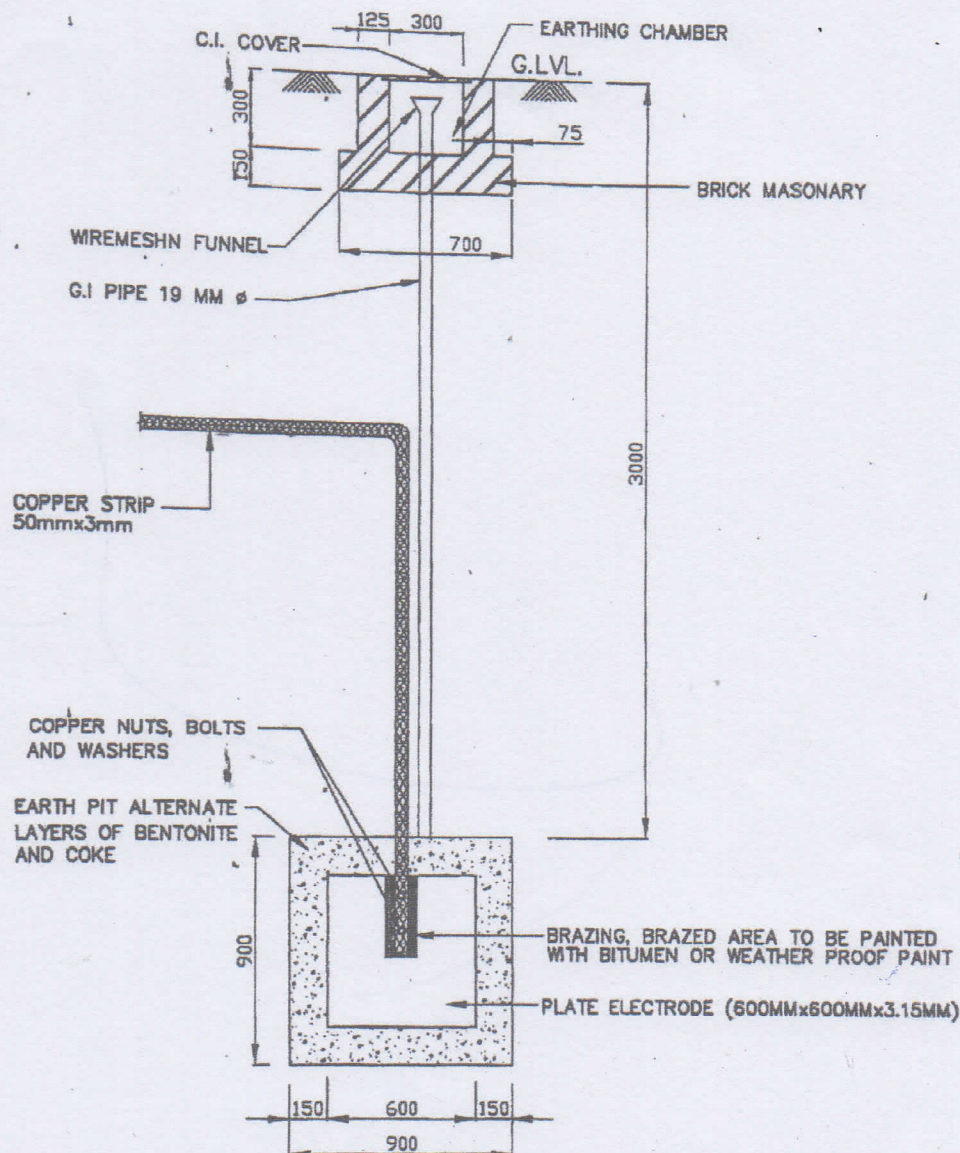
- 1) CPP Portal(e Publishing)
- 2) webupdates.pbns@gmail.com with a request to publish the Notice inviting quotation on prasarbharati.gov.in
- 3) prasarbharatisupport@c1india.com with a request to publish the Notice inviting quotation on prasarbharati.eproc.in
- 4) Akashvani Guwahati office Notice Board.

  
Akhlesh Chand Yadava  
Assistant Engineer

For, Dy. Director General(E)/HOO  
Akashvani Guwahati



# COPPER PLATE EARTHING



## NOTE:-

1. PIT SIZE OF 900x900x3900(or more) MM IS EXCAVATED & COPPER PLATE OF SIZE 600x600x3.15 MM IS PLACED VERTICALLY IN THE EXCAVATED PIT. THE PLATE SHALL BE CONNECTED TO COPPER STRIP OF 50x3 MM. THE BOLTS, NUTS, CHECK NUTS & WASHERS SHALL BE OF COPPER. THE PIT IS FILLED WITH ALTERNATE LAYERS OF COKE & BENTONITE UP TO A DEPTH OF 900 MM & REMAINING PORTION FILLED WITH LOOSE SOIL WITHOUT STONES. THE MASONARY CHAMBER AT GROUND LEVEL OF SIZE 700x700x450 MM WITH A HOLE IN MIDDLE TO PASS THE G.I. PIPE OF 19 MM DIA WITH A PROVISION FOR FUNNEL & PROVIDED WITH C.I. FRAME & COVER WITH LOCKING ARRANGEMENTS. THE FUNNEL SHALL BE FIXED WITH WIREMESH. THE MAIN HOLE COVER SHALL BE PAINTED & MARKED WITH RESISTANCE OF THE EARTH.
2. ALL THE DIMENSIONS ARE IN MILLIMETRES.

CHAUHAN	MAY2016
DRN BY	DATE

ALL INDIA RADIO  
P & D UNIT  
NEW DELHI

DRG. No. TM-16599