



प्रसार भारती / Prasar Bharati
भारत का लोक सेवा प्रसारक / India's Public Service Broadcaster
कार्यालय: अपर महानिदेशक (अभि.) (उत्तरी क्षेत्र)/ O/o Additional Director General (E) (NZ)
आकाशवाणी एवं दूरदर्शन / Akashwani & Doordarshan
आठवां तल, सूचना भवन/ 8th floor, Soochna Bhawan,
सी.जी.ओ. कॉम्प्लेक्स, नई दिल्ली 110003/CGO Complex, New Delhi-110003



सत्यम् शिवम् सुन्दरम्

No. 2/4/DDM/ARCA/2V 500Ah Battery/ DTH/ 2024-25

Dated: 23.08.2024

Subject: Submission of budgetary quote for Supply, Installation, Testing and Commissioning of Three battery Banks for 200 KVA UPS (1+1) and 200 KVA UPS (1+0) in Doordarshan Ku-Band DTH Earth Station at Todapur, New Delhi on buy back basis.

1. The proposed details of the upcoming tender are enclosed herewith to offer budgetary quote and comments, if any, by prospective bidders/firms.
2. Bidders/firms are requested to provide information about content in respect of store/work along with budgetary quote.
3. Bidders/firms may please submit the above detail on or before due date by e-mail to **anangpalsingh@prasarbharati.gov.in** at following Address.


Deputy Director (Engg.)
Room No. 899, O/o ADG(E-NZ)
Akashwani & Doordarshan, 8th floor, CGO Complex,
Soochna Bhawan, New Delhi-110003

Budgetary Quotation for: Supply, Installation, Testing and commissioning of battery Banks for 200 KVA UPS (1+1) and 200 KVA UPS (1+0) in Doordarshan Ku-Band DTH Earth Station at Todapur, New Delhi on buy back basis.

Due Date to offer Comments: 10.09.2024

Enclosed:

1. Budgetary Quotation form of the upcoming tender is enclosed herewith to offer Quote and comments, if any, by prospective bidders/firms.
2. Drawing of the existing battery Bank.


Anang Pal Singh
Deputy Director (Engg.)
For ADGE(NZ)



प्रसार भारती / Prasar Bharati
भारत का लोक सेवा प्रसारक / India's Public Service Broadcaster
कार्यालय: अपर महानिदेशक (अभि.) (उत्तरी क्षेत्र)/ O/o Additional Director General (E) (NZ)
आकाशवाणी एवं दूरदर्शन / Akashwani & Doordarshan
आठवां तल, सूचना भवन/ 8th floor, Soochna Bhawan,
सी.जी.ओ. कॉम्प्लेक्स, नई दिल्ली 110003/CGO Complex, New Delhi-110003



No. 2/4/DDM/ARCA/2V 500Ah Battery/ DTH/ 2024-25

Dated: 23.08.2024

Budgetary Quotation Form

Subject: Supply, Installation, Testing and commissioning of three battery Banks for 200 KVA UPS (1+1) and 200 KVA UPS (1+0) in Doordarshan Ku-Band DTH Earth Station at Todapur, New Delhi on buy back basis.

Last date of receipt of budgetary quotation in this office: 10.09.2024 up to 12:00Hrs.

Please read carefully the terms and conditions given the enquiry quotation form.

No.	Description	Qty	Rate	CGST	SGST	IGST	Amount
1	Supply of 2 Volt, 500 Ah, Sealed Maintenance free, Valve Regulated Lead Acid (VRLA) Batteries. Make: Model:	702 Nos.					
2	Supply of steel frames and accessories required for the completion of Job.	1 Job					
3	Dismantling of the existing three battery banks and Installation, Testing and commissioning of the supplied batteries in three Bank configuration (234 Nos. of battery in each bank)	1 Job					
4	Buy back of existing batteries (Make: Exide, Model: UPST 500AH)	702 Nos.					

5	Buy back of existing steel frames and other accessories used for the old batteries.	1 Job					
	Total						

Note:

1. Quantity of Material & Scope may increase or decrease as per actual requirement/constraints at site.
2. Delivery at: Doordarshan Ku-Band DTH Earth Station at Todapur, New Delhi.
3. Consignee: Doordarshan Ku-Band DTH Earth Station at Todapur, New Delhi
4. Completion Period: Supply of material & completion of scope within 90 days from the date of order.
5. Validity: 120 days
6. Payment terms:
 - a. 95% Payment on completion/execution of in good condition at site.
 - b. Balance payment of 05% will be paid after guarantee/warranty period of Three year. However, payment can be released against FDR/Account Payee Demand Draft/Banker's Cheque of equivalent amount in favour of Chief Engineer NZ, Akashvani and Doordarshan, New Delhi valid for guarantee period at least.
7. Performance Security:
 - a. The firm/contractor should submit performance security deposit in the form of FDR from a schedule commercial bank valid for 03 Year in favor of Chief Engineer NZ, Akashvani and Doordarshan, New Delhi.
 - b. The Performance Security Deposit shall be 05% of cost of the order/Contract value.


Name (in capital) _____

Seal: (Signature of the Bidder)



DRAWING OF THE EXISTING BATTERY BANK

Exide make Powersafe 2V VRLA Cell model UPST 500AH, (4 cells in one module).

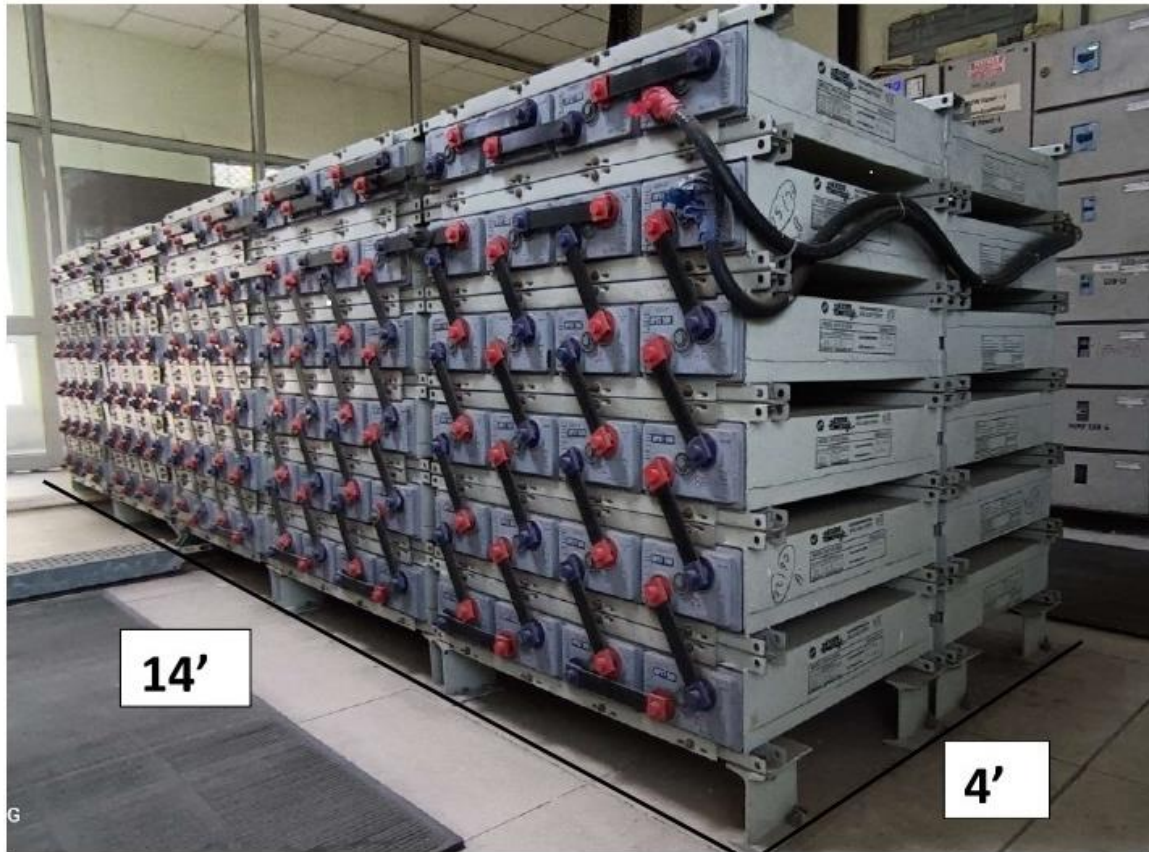

Area covered

14'x4

Height=approx. 4'

Exide UPST 500AH 4 cells per module

Battery Model	Nominal Voltage (V)	Rated capacity (Ah) 10 hr, 1.75 v/cell	Module Dimensions (mm)			Overall Module Dimensions (mm) with cells and connector shrouds			Total Weight Module with cells (Kg) $\pm 5\%$
			L ± 5	D ± 5	H ± 5	L ± 5	D ± 5	H ± 5	
4UPST500	8	500	880	563	176	880	596	176	154,90

Signature